

Modern Yard LLC

TEST REPORT

SCOPE OF WORK

Modern Yard FireGuard™ Fence Panel

REPORT NUMBER

251013008SHF-001-R1

TEST DATE(S)

2025-10-15- 2025-10-27

ORIGINAL ISSUE DATE

2025-10-28

PAGES

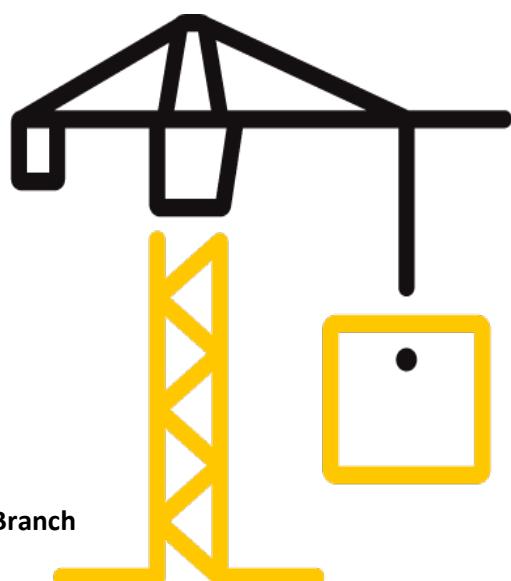
6

DOCUMENT CONTROL NUMBER

LFT-APAC-SHF-OP-10k(January 13, 2025)

© 2025 INTERTEK

Intertek Testing Services Shenzhen Ltd. Shanghai Fengxian Branch



Test Report

Modern Yard LLC

1. This report is invalid without company's special seal for testing on the assigned page.
2. This report is invalid without an authorized person's signature.
3. This report is invalid if altered.
4. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Don't copy this report in partial without any official approval in writing by our company. This report is invalid without re-stamping the special seal for testing in copying report.
5. This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.
6. Except for the obligation, responsibility and liability (if any) for the appropriateness and professionalism of afore-mentioned testing itself within the scope and amount of the testing fee received, Intertek does not and will not accept any other obligation or liability.
7. If the Client has any questions about the test results, Intertek B&C should be informed within the storage period of the samples. The sample storage period ends 5 working days after the official report issue date. Samples of certification program are retained for the period required by the certification rules. The samples storage period shall be calculated according to the issue date of the original report in the case of quoting results and modifying reports.
8. Intertek B&C will service this report for the entire test record retention period. The test record retention period ends 6 years after this report original issue date. The test record retention period for certification program is 10 years. Test records and other pertinent project documentation will be retained for the entire test record retention period.
9. The report was digital signed by Shanghai Intertek Group plc, please use Adobe Acrobat Reader to verify the authenticity.



Test Report

Original Issue Date: 2025-10-28 Revised Date: 2025-10-29 Intertek Report No. 251013008SHF-001-R1

Applicant: Modern Yard LLC

Address: 30042 Mission Blvd, Ste 121, Hayward CA 94544, USA

Attn: Pengcheng Gan

Test Type: Performance test, samples provided by the applicant.

Product Information

Product Name	Model	Specification
Modern Yard FireGuard™ Fence Panel	myFireGuard	6ft x 12in x 3/4in
Sample ID	Sample Amount	Sample Received Date
S251013008SHF.001	12 pcs	2025-10-07
Sample Description	Brand	
4ft x 12.2in x 3/4in	Modern Yard	

Test Methods And Standards

Test Standard	ASTM E84-24 Standard Test Method for Surface Burning Characteristics of Building Materials
Specification Standard	/
Test Conclusion	The samples were tested according to the above standards, and the results are shown in the following page.

Note:

1. This report does not involve sampling. The report only reflects conformity of the tested items of the samples provided by the testing applicant. Representativeness and authenticity of the submitted samples are responsibilities of the testing applicant.

Report Authorized



 Name: Lu Cheng Name: Haijun Li
 Title: Reviewer Title: Project Engineer

 (1)

Test Report

Original Issue Date: 2025-10-28

Revised Date: 2025-10-29

Intertek Report No. 251013008SHF-001-R1

Test Items, Method and Results:

Test Method: ASTM E84-24 Standard Test Method for Surface Burning Characteristics of Building Materials

Specimen Mounting Method:

The 24.02-ft. long test specimen was consisted of twelve 4.0-ft. long x 12.2-in. wide x 0.75-in. thick "Modern Yard FireGuard™ Fence Panel". Two "Modern Yard FireGuard™ Fence Panel" were placed in a overlapping way at the joints to get a 24.02-in. width.

The both sides of the specimen were same.

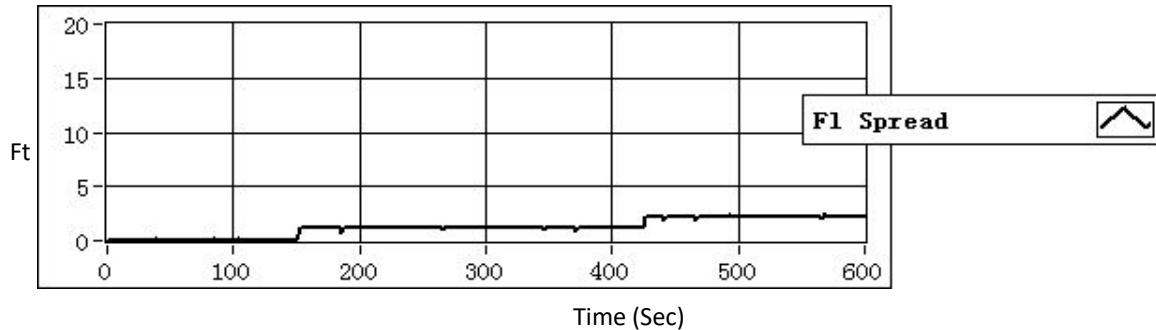
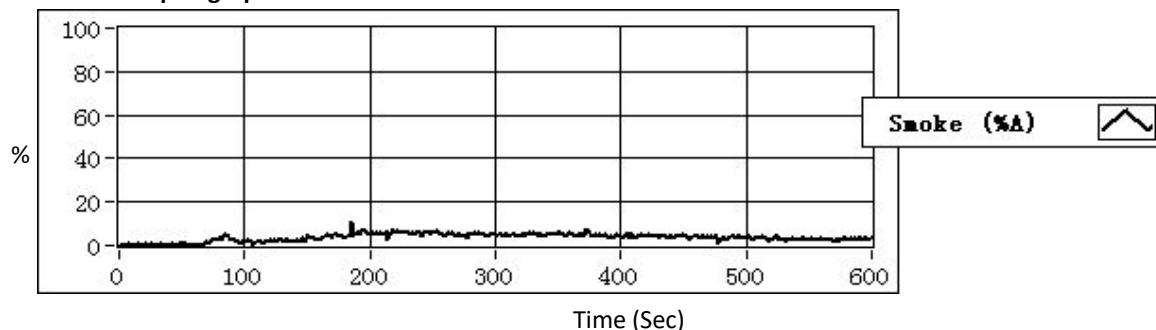
The specimen was supported with 0.25-in. diameter metal rods that were spaced approximately every two feet.

Test Observation (min:sec)

Melting	Blistering	Transient Ignition	Steady Ignition	Flaming drops
/	/	1:47	2:01	/
Floor Flames	Sagging	Falling	Cracking	After Flame
/	/	/	/	/

Test Result

Flame Spread Index (FSI)	5	Smoke Developed Index(SDI)	45
--------------------------	---	----------------------------	----

Flame spread graph**Smoke developed graph**

Test Report

Original Issue Date: 2025-10-28

Revised Date: 2025-10-29

Intertek Report No. 251013008SHF-001-R1

Test Items, Method and Results:**Commentary on Classification (for information only)**

Neither ASTM E84 nor UL 723 include classification criteria for the results obtained from testing. The international Building Code® (IBC), NFPA 101: Life Safety Code® (NFPA 101), and NFPA 5000: Building Construction and Safety Code® (NFPA 5000) all describe a set of classification criteria required for interior wall and ceiling finish materials based on Flame Spread Index and Smoke Developed Index when tested in accordance with ASTM E84 or UL 723. The classification criteria for all three model codes is the same:

Class	Flame Spread Index	Smoke Developed Index
A	0-25	0-450
B	26-75	0-450
C	76-200	0-450

Note that classification under this scheme for interior wall and ceiling finishes does not strictly apply to all products or materials tested in accordance with ASTM E84 or UL 723 because not all products or materials are recommended or suitable for use as interior wall or ceiling finish materials in buildings, regardless of the surface burning characteristics. Consult with the product manufacturer and the local authority having jurisdiction (AHJ) regarding specific applications of a given product or material.

Test Report

Original Issue Date: 2025-10-28

Revised Date: 2025-10-29

Intertek Report No. 251013008SHF-001-R1

Appendix A: Sample Received Photo



CHINA FENGHUA
6224